

NOTES

1. CALCULATE UPLIFT DESIGN PRESSURES IN ACCORDANCE WITH ASCE-7.
2. THE CORNERS MAY BE TREATED AS PERIMETERS IF THE PARAPET IS GREATER THAN OR EQUAL TO 3 FT ON ALL SIDES ACCORDING TO ASCE-7.
3. PERIMETER AND CORNER DIMENSIONS FOR BUILDINGS LESS THAN 60 ft. IN HEIGHT:
EQUAL TO THE SMALLER OF:
 - 0.1 TIMES THE BUILDING LESSER PLAN DIMENSION (OVERALL LENGTH AND WIDTH)
 - 0.4 TIMES THE EAVE HEIGHT
 - BUT WILL NEVER MEASURE LESS THAN 0.04 TIMES THE BUILDING LESSER PLAN DIMENSION AND NEVER LESS THAN 3 ft.
4. PERIMETER AND CORNER DIMENSIONS FOR BUILDINGS GREATER THAN 60 ft. IN HEIGHT:
 - EQUAL TO 0.1 TIMES THE BUILDING LESSER PLAN DIMENSION (OVERALL LENGTH AND WIDTH), BUT NEVER LESS THAN 3 ft.
 - CORNERS ARE "L" SHAPED WITH LEGS TWICE THE WIDTH OF THE PERIMETER


FASTENING DEFINED PER ZONE

FIELD FASTENING - 9" O.C. AT LAPS
& 2 EQUALLY SPACED ROWS BETWEEN LAPS
AT 9" O.C.

PERIMETER FASTENING - 9" O.C. AT LAPS
& 6 EQUALLY SPACED ROWS BETWEEN LAPS
AT 9" O.C.

CORNER FASTENING - 9" O.C. AT LAPS
& 6 EQUALLY SPACED ROWS BETWEEN LAPS
IN BOTH DIRECTIONS AT 9" O.C.

CORNER DEFINITION

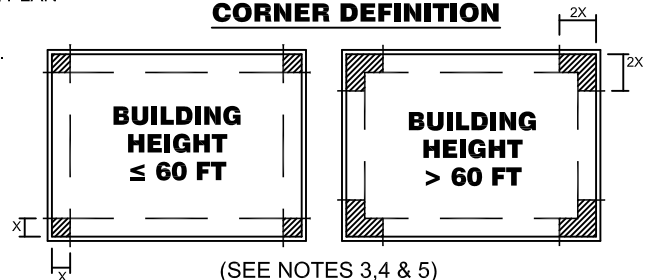

TAPE & STAPLE ATTACHED BASESHEET (9"-9"-9" O.C.)

DRAWING NO.

BM-9,9,9-TS

SCALE
N.T.S

ISSUE DATE
06-17-19

REV. NO.

CAD FILE:

BM-9-9-9-TS TAPE & STAPLE FASTENING PATTERN

Johns Manville is a Manufacturer of commercial roofing products and offers this general conceptual information to you as a courtesy. This complimentary assistance is not to be used or relied upon by anyone as a substitute for professional engineering design and documentation required by building code, contract, or applicable law. By accepting these comments you agree they do not constitute any representations, endorsements of, or an assumption by Johns Manville of any liability for either the adequacy of the design of this building or any other material not supplied by Johns Manville.

