


RADIUS CORNERS
OF DETAIL STRIP

1" (25 mm) GAP BETWEEN
MEMBRANE SHEETS


1 1/2" (38 mm) MINIMUM
CONTINUOUS WELD

JM 8" TPO REINFORCED
COVER STRIP HEAT
WELDED TO MEMBRANE

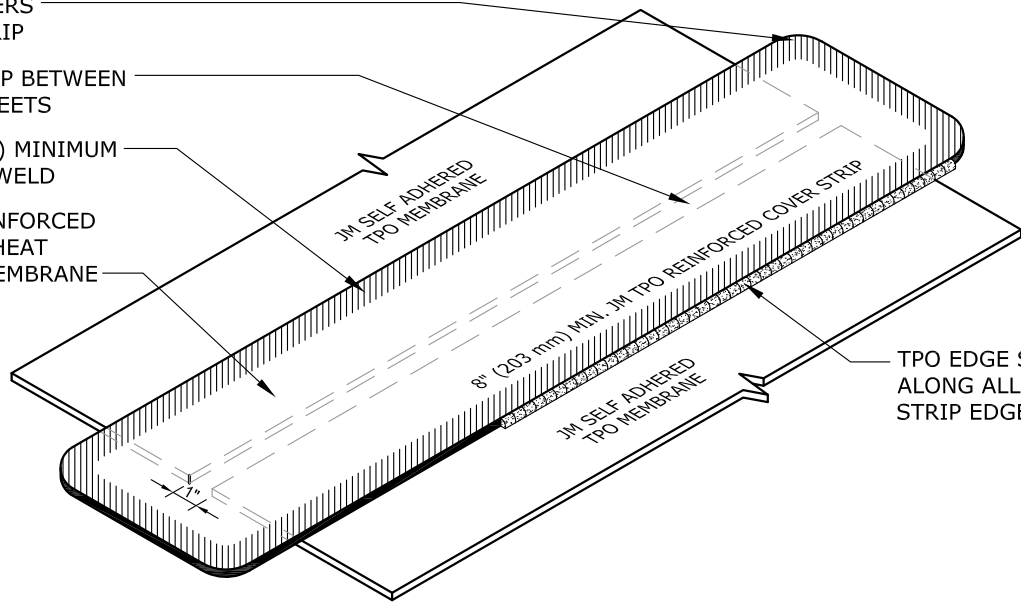

TPO EDGE SEALANT
ALONG ALL COVER
STRIP EDGES

ISOMETRIC VIEW

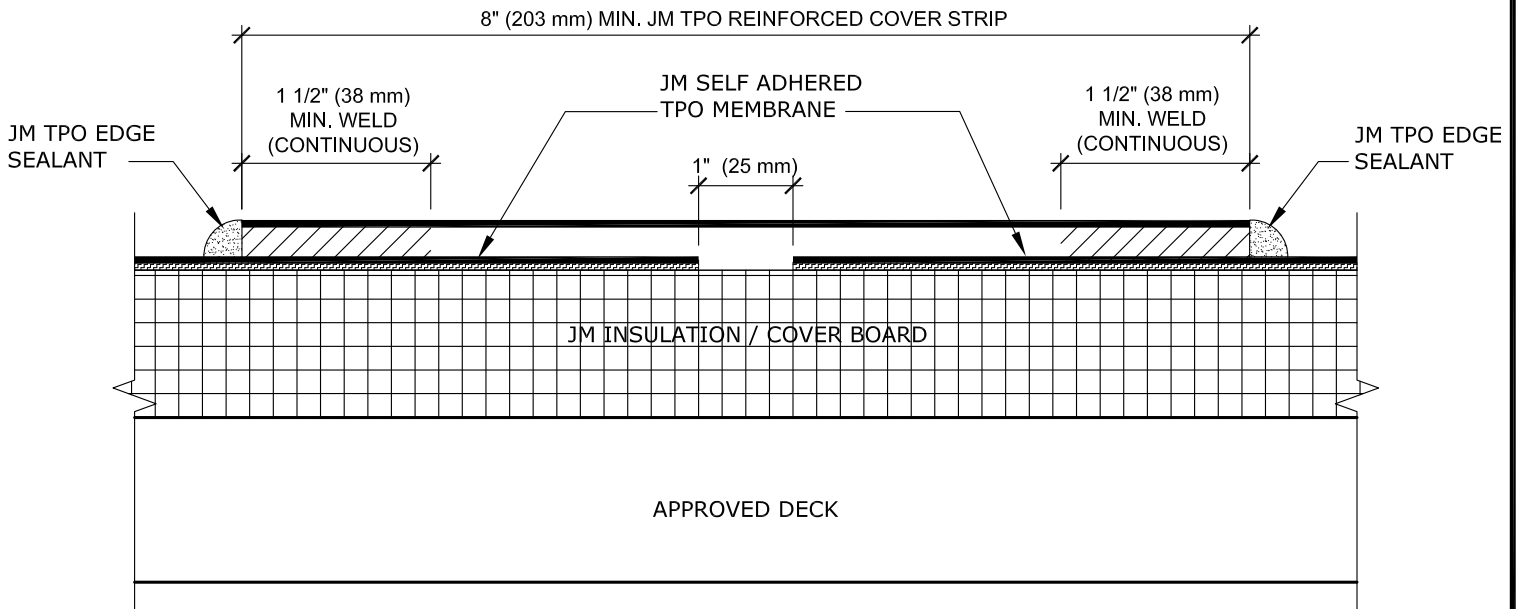

NOTES:

1. REFER TO JOHNS MANVILLE WEBSITE (www.jm.com) FOR MOST UP-TO-DATE INFORMATION.
2. PLEASE SEE SINGLE PLY FLASHING SPECIFICATIONS FOR A FULL DESCRIPTION OF INSTALLATION INSTRUCTIONS AND REQUIREMENTS WHICH ARE CONSIDERED A PART OF THIS DETAIL.
3. ANY CARPENTRY OR METAL WORK SHOULD BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS AND/OR PROJECT SPECIFICATIONS. THESE COMPONENTS SHOULD BE REVIEWED AND APPROVED BY A LICENSED DESIGN PROFESSIONAL.
4. JM TPO EDGE SEALANT IS REQUIRED ON ALL CUT OR NON-ENCAPSULATED EDGES OF REINFORCED MEMBRANE. THIS INCLUDES FACTORY CUT MEMBRANE (SEE DETAIL T-MS-01).

DRAWING NO.

T-MS-11

NEW DETAIL

SCALE
N.T.S

ISSUE DATE
5-22-17

MEMBRANE TYPE:
JM SELF ADHERED TPO

MAXIMUM GUARANTEE TERM:
20 YEAR

TPO SELF ADHERED MEMBRANE BUTTED END LAP

Johns Manville is a manufacturer of commercial roofing products and offers this general conceptual information to you as a courtesy. This complimentary assistance is not to be used or relied upon by anyone as a substitute for professional engineering design and documentation required by building code, contract, or applicable law. By accepting these comments you agree they do not constitute any representations, endorsements of, or an assumption by Johns Manville of any liability for either the adequacy of the design of this building or any other material not supplied by Johns Manville.

