

**DESCRIPTION**

Micro-Lok® HP Ultra fiber glass pipe insulation is a high-performance pipe insulation with a polypropylene (PP)-coated factory-applied vapor-barrier jacket. Micro-Lok HP Ultra is made from rotary glass fibers bonded with a thermosetting resin and produced in 36" (0.92 m) lengths and is used to insulate standard iron pipe, plastic pipe and copper tubing. The PP-coated jacket includes a longitudinal, self-sealing closure lap and matching butt strip. The jacket system is adhered to each fiber glass section using a specially formulated adhesive to ensure jacket securement.

The factory-installed tape system permits installation at ambient temperatures down to 20°F (-7°C) and will not soften or separate when exposed to high ambient temperatures and humidity.

Micro-Lok HP Ultra's PP-coated factory-applied vapor retarder jacket can be wiped down using a soft cloth and some soapy water. The jacket can also resist minor exposure to transient liquid water. Micro-Lok HP Ultra is intended for indoor use. Any outdoor use of Micro-Lok HP Ultra requires separate weather protection.

**USES**

Micro-Lok HP Ultra fiber glass pipe insulation is suitable for installation over hot, cold, concealed and exposed piping systems with operating temperatures up to 850°F (454°C). Weather-protective jacketing is required for outdoor applications. Pipe operating below ambient temperature requires all joints to be sealed with factory-applied, self-seal lap and butt strips.

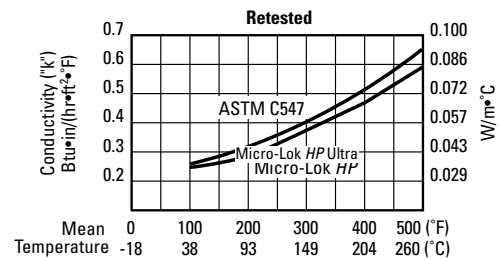
**PHYSICAL PROPERTIES**

Service Temp. Range (ASTM C411)	0°F to 850°F (-18°C to 454°C)
Moisture Sorption	<5% by weight
Alkalinity	<0.06% expressed as Na <sub>2</sub> O
Corrosivity (ASTM C665)	Does not accelerate
Capillarity	Negligible (after 24 hours)
Shrinkage (ASTM C356)	None
Microbial Growth (ASTM C1338)	Does not promote microbial growth
Surface Burning Characteristics	Composite FHC 25/50 per ASTM E84, CAN/ULC S102.2
Limited Combustibility	<3500 BTU/lb
<b>Jacketing (Poly ASJ)</b>	ASTM C1136 (Type I, II, III, IV)
Water Vapor Permeance (ASTM E96 – Procedure A)	0.02 perms max.
Bursting Strength (ASTM D774)	100 psi (8.7.0Kg/CM <sup>2</sup> )
Tensile Strength (ASTM D828)	75 lbs./in. (13.1 N/mm) width min. (MD) 60 lbs./in. (10.5 N/mm) width min. (CD)

**SPECIFICATION COMPLIANCE**

- ASTM C547 Type I (Replaced HH-I-558B, Form D, Type III, Class 12, Class 13 up to 850 F (454 C) )
- ASTM C585 – Dimension Standard for pipe ID only
- ASTM C1136 (Jacketing ) Replaces HH-B-100B, Type I & II)
- MIL-DTL-32585
- MIL-I-22344D, MIL-PRF-22344E
- NRC 1.36, ASTM C795, Mil-I-24244C, MIL-DTL-24244D
- Coast Guard/IMO Approved 164.109/56/0 (plain, unjacketed only – excluding 7/8 x ½ [22 mm x 13 mm], ½ x ½ [13 mm x 13 mm])
- MEA Complaint
- California Bureau of Home Furnishings and Thermal Insulation – Registry Number CA-T040 (CO)
- Firestop Assemblies: Meets requirement for jacketed fiber glass pipe insulation product at or above 3.5 pcf.
- ASTM E84, CAN ULC S102.2 – 25/50 listed and labeled Intertek testing laboratories
- ASTM D2863 – Limiting Oxygen Index (LOI) minimum 31

MECH-255 09/18/18 (Replaces 05/18/18)


**THERMAL CONDUCTIVITY ("K") \***


Mean Temperature	°F	75	100	200	300	400	500
°C	24	38	93	149	204	260	
<b>Btu•in/(hr•ft<sup>2</sup>•°F)</b>	0.23	0.24	0.28	0.34	0.44	0.55	
<b>W/m•°C</b>	0.034	0.035	0.040	0.049	0.063	0.079	

\*Apparent thermal conductivity values are determined by applying procedures dictated per ASTM C1045 on test data obtained using ASTM Test Method C335. All values are based on nominal manufacturing and testing parameters, are subject to normal variation, and are not guaranteed for specification purposes or otherwise.

**GREEN BUILDING ATTRIBUTES**

Manufacturing Location	Defiance, Ohio (43512)	
Recycled Content (glass only)	41%	
Recycled Content (total product)	33%	
Volatile Organic Compounds (ASTM D5116)	Total	0.15 g/l
(Analysis ASTM D6196 & ASTM D5197)		
Fiber Glass Pipe Insulation	Formaldehyde	0.009 ppm
	Aldehydes	0.009 ppm
Volatile Organic Compounds (Calculated)	Total	<49 g/l
Self-Sealing Lap & Butt Strips		

**GREEN BUILDING CERTIFICATIONS**

GREENGUARD®	Certified
GREENGUARD® GOLD	Certified
LEED® Credits	
LEED-NC	

 See [JM.com/buildgreen](http://JM.com/buildgreen)  
 JM LEED Credit Guide (HIG-1231)

GREENGUARD® Certified products have been screened for more than 10,000 volatile organic compounds (VOCs) and meet stringent standards for low chemical emissions based on established criteria from key public health agencies



# MICRO-LOK® HP ULTRA

## HIGH-PERFORMANCE FIBERGLASS PIPE INSULATION

## DATA SHEET

## SIZE AVAILABILITY

Insulation Thickness		Iron Pipe Size Range		Copper Tubing Size Range	
in.	mm	in.	mm	in.	mm
½	13	½-6	13-152	⅝-4⅝ <sup>§</sup>	16-105
1	25	½-24	13-610	⅝-6⅝	16-156
1½	38	½-24	13-610	⅝-6⅝	16-156
2	51	½-24	13-610	1⅝-6⅝	29-156
2½	64	1-24	25-610	1⅝-6⅝	35-156
3	76	1-24	25-610	1⅝-6⅝	35-156
3½	89	1½-24*	38-610	-	-
4	102	3-24**	76-610	-	-
4½	114	3-24†	76-610	-	-
5	127	3-20††	76-508	-	-

## Notes:

\*2½" and 23" IPS not available in this insulation thickness.

\*\*22" and 23" IPS not available in this insulation thickness.

†21", 22" and 23" IPS not available in this insulation thickness.

††19" IPS not available in this insulation thickness.

§3⅝" CTS not available in this insulation thickness.

## QUALIFICATIONS FOR USE

A sufficient thickness of insulation must be used to keep the maximum surface temperature of Micro-Lok HP Ultra below 150°F (66°C). In addition, at operating temperatures above 500°F (260°C), Micro-Lok HP Ultra pipe insulation must be applied in a thickness ranging from 2" (51 mm) minimum to 6" (152 mm) maximum.

During initial heat-up to operating temperatures above 350°F (177°C), an acrid odor and some smoke may be given off as the organic binders used in the fiber glass pipe insulation begin to decompose. When this occurs, caution should be exercised to ventilate the area well. This loss of binder does not directly affect the thermal performance of the pipe insulation, but the compressive strength and resiliency of the product are reduced. For applications with excessive physical abuse or vibration at high temperatures, consult your local Insulation Systems Market Development Manager for alternate material recommendations.

## CHILLED WATER SYSTEMS

For chilled water systems, see Chilled Water InsulSpec™ – 3-Part Specification, MECH-239.

\*Apparent thermal conductivity values are determined by applying procedures dictated per ASTM C1045 on test data obtained using ASTM Test Method C335. All values are based on nominal manufacturing and testing parameters, are subject to normal variation, and are not guaranteed for specification purposes or otherwise.

## APPLICATION RECOMMENDATIONS\*

## MICRO-LOK HP ULTRA PIPE INSULATION AND BUTT STRIPS

- Do not apply Micro-Lok HP Ultra if air temperature is below 20°F (-7°C) or above 130°F (54°C) due to the effect of temperature on tape performance. We recommend stapling when application falls outside this temperature range.

When stapling, we recommend mastic be applied over staples to prevent moisture penetration.

- If stored below 20°F (-7°C) or above 130°F (54°C), insulation cartons should stand within the recommended temperature range for 24 hours prior to application.
- Once release paper is removed, both adhesive and lap must be kept free of dirt and water, and the lap sealed immediately.
- When adhered, the lap and butt strips must be pressurized by rubbing firmly with a plastic squeegee or the back of a knife blade to ensure positive closure.
- Do not reseal the lap or butt strip once applied. This could compromise the quality of the sealed jacket system.

\*For complete application recommendations and installation instructions, see MECH-261 InsulSpec Specifications.



717 17th St.  
Denver, CO 80202  
800-654-3103  
www.JM.com

### North American Sales Offices, Insulation Systems

#### Eastern Region and Canada

P.O. Box 158  
Defiance, OH 43512  
800-334-2399  
Fax: 419-784-7866

#### Western Region

P.O. Box 5108  
Denver, CO 80217  
800-368-4431  
Fax: 303-978-4661

The physical and chemical properties of MicroLok® HP Ultra high-performance fiberglass pipe insulation listed herein represent typical, average values obtained in accordance with accepted test methods and are subject to normal manufacturing variations. They are supplied as a technical service and are subject to change without notice. Numerical flame spread and smoke developed ratings are not intended to reflect hazards presented by these or any other materials under actual fire conditions.

**All Johns Manville products are sold subject to Johns Manville's standard Terms and Conditions, which includes a Limited Warranty and Limitation of Remedy. For a copy of the Johns Manville standard Terms and Conditions or for information on other Johns Manville thermal insulation and systems, visit [www2.jm.com/terms-conditions](http://www2.jm.com/terms-conditions) or call (800) 654-3103.**